




INSULATING CLOTHES GLOVAREX LINE

■ HIGH VOLTAGE RUBBER INSULATING SLEEVES

< STRAIGHT TYPE >

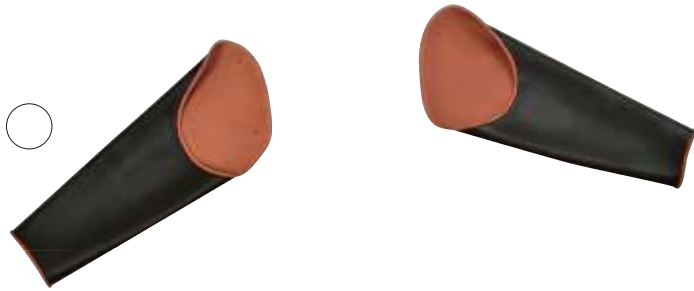

| ITEM NO. | SIZE | A.C. PROOF TEST VOLTAGE | A.C. MAXIMUM USE VOLTAGE | CLASS |
|--------------|------|-------------------------|--------------------------|-------|
| YS-138-09-02 | M | 10kV/3min | 7.5kV | 1 |
| YS-138-09-03 | LG | | | |
| YS-138-09-04 | XLG | | | |
| YS-138-10-02 | M | 20kV/3min | 17kV | 2 |
| YS-138-10-03 | LG | | | |
| YS-138-10-04 | XLG | | | |
| YS-138-11-02 | M | 30kV/3min | 26.5kV | 3 |
| YS-138-11-03 | LG | | | |
| YS-138-11-04 | XLG | | | |
| YS-138-12-02 | M | 40kV/3min | 36kV | 4 |
| YS-138-12-03 | LG | | | |
| YS-138-12-04 | XLG | | | |

< CURVE TYPE >




| ITEM NO. | SIZE | A.C. PROOF TEST VOLTAGE | A.C. MAXIMUM USE VOLTAGE | CLASS |
|--------------|------|-------------------------|--------------------------|-------|
| YS-138-21-01 | S | 10kV/3min | 7.5kV | 1 |
| YS-138-21-02 | M | | | |
| YS-138-21-03 | LG | | | |
| YS-138-21-04 | XLG | | | |
| YS-138-22-01 | S | 20kV/3min | 17kV | 2 |
| YS-138-22-02 | M | | | |
| YS-138-22-03 | LG | | | |
| YS-138-22-04 | XLG | | | |
| YS-138-23-01 | S | 30kV/3min | 26.5kV | 3 |
| YS-138-23-02 | M | | | |
| YS-138-23-03 | LG | | | |
| YS-138-23-04 | XLG | | | |
| YS-138-24-01 | S | 40kV/3min | 36kV | 4 |
| YS-138-24-02 | M | | | |
| YS-138-24-03 | LG | | | |
| YS-138-24-04 | XLG | | | |



INSULATING CLOTHES GLOVAREX LINE

< ACCESSORIES >

STRAP

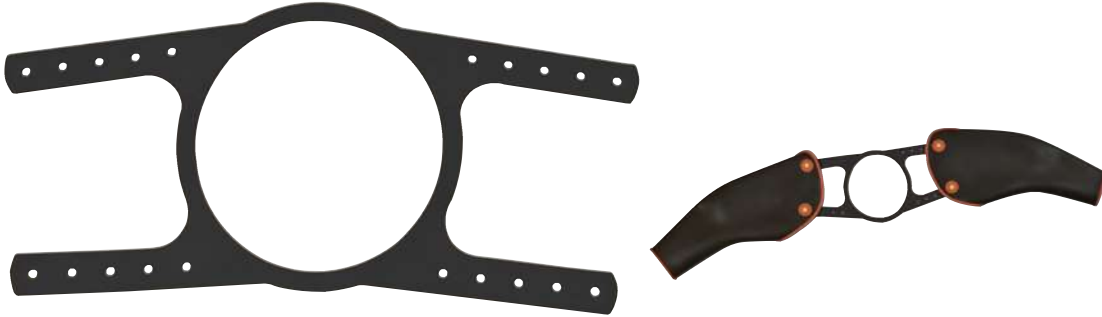

ITEM NO.

YS-138-25-02

BUTTON



ITEM NO.

YS-138-26-01



YOTSUGI CO.,LTD.

Tokyo Office : 2-6-13, Kyobashi, Chuo-ku, Tokyo, Japan.

〒104-0031

TEL : (81) 3-3563-5616

FAX : (81) 3-3535-0789

URL: <http://www.yotsugi.co.jp>